



# model AX16

AXION Advantage® Upgrade Kit


## FEATURES & BENEFITS

### EYE/FACE WASH

AXION® MSR eye/face wash head uses an inverted directional laminar flow to sweep contaminants away from the vulnerable nasal cavity.

## OPTIONS

For more information, visit [www.hawsc.com](http://www.hawsc.com) or call (888) 640-4297.

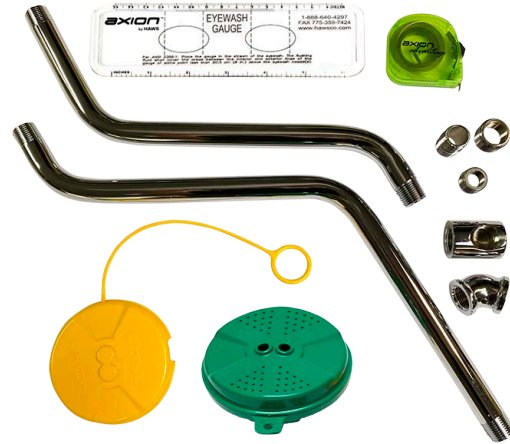

## SPECIFICATIONS

Model AX16 AXION Advantage® eye/face wash system shall include the AXION® MSR eye/face wash head, chrome-plated connecting hardware, ANSI eyewash gauge, tape measure, complete installation instructions and ANSI compliance information. The AXION Advantage system is ANSI compliant when installed correctly based on manufacturer guidelines and when tested against the ANSI Z358.1 checklist included with the product. The materials provided offer complete ANSI compliance tools and instructions. At the current time, ANSI does not regulate product brands, models, or the interchange of product components.

## APPLICATIONS





Perfect for installed laboratory and hose-mounted emergency equipment that might be outdated, under-performing, or potentially out of compliance with the current ANSI Z358.1 standard. Specifically, this system can replace eyewash heads that flow too low or high, unevenly, or uncomfortably. The user will be assured their equipment will comply with ANSI emergency protocol using the best performing eye/face wash head on the market.

**IMPORTANT:** UNITS MUST BE FULLY TESTED AND CHECKED FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADING THE INSTALLATION.

\* NOTE CORRESPONDING LETTERS ON INSTALLATION DRAWING.

PARTS NOT SHOWN BUT SUPPLIED

- AXION EYE/FACE WASH ASSEMBLY
- MEASURING TAPE
- ANSI MIN. PERFORMANCE CHECKLIST
- EYEWASH GAUGE  
(IF PRESENT, REMOVE PAPER BACKING PRIOR TO USE)

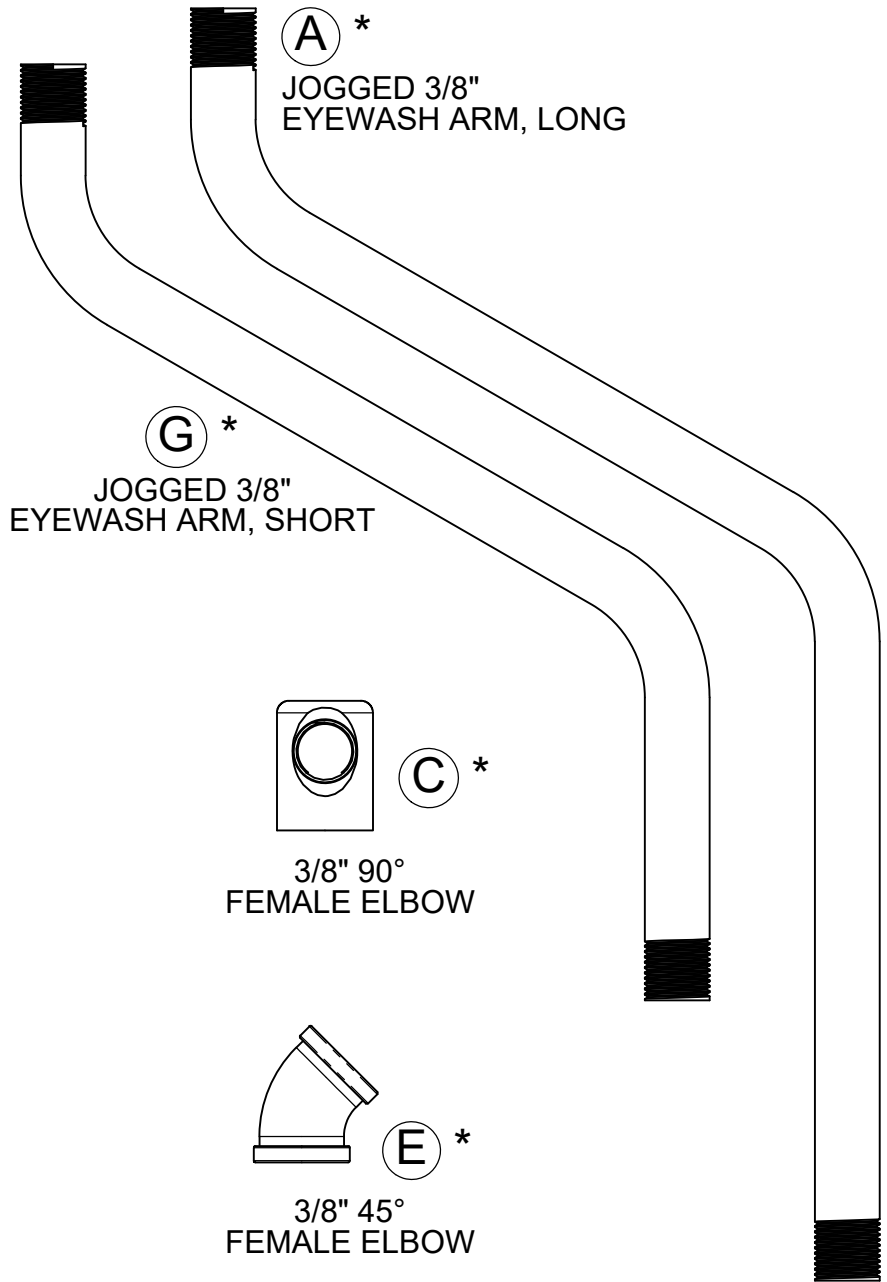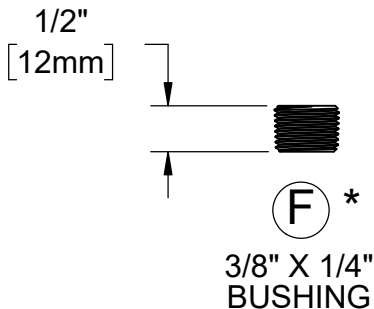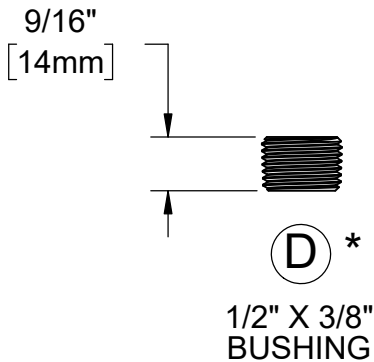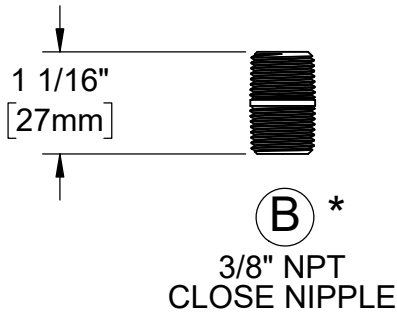

		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSO.COM WEBSITE: WWW.HAWSO.COM	
ECN: 5735	REV. ECN: 5735	BY: JL	MODEL(S) AX16 AXION® ADVANTAGE™
DRAWN: JL	DATE: 08/19/21	CHKD: DP	PART NUMBER 0510002012
APPROVED: JL	DATE: 09/21/21	SCALE: 1:2	REVISION 1
DRAWING TYPE: PARTS BREAKDOWN		SIZE: A	SHEET 1 OF 1


WHEN ORDERING PARTS, PLEASE SPECIFY PART NUMBER

**INITIAL STEPS**

- REMOVE THE EXISTING EYEWASH OR SPRAY HEAD; FIND A SUITABLE CONNECTION FOR INSTALLING THE AXION HEAD.
  - THIS KIT CAN ACCOMMODATE THE EXISTING MODEL CONNECTION TYPES LISTED IN THE TABLE BELOW.
  - FOR VERTICALLY-MOUNTED HOSE PRODUCTS, INCLINE THE HEAD FORWARD WITH THE SUPPLIED 45° ELBOW.

EXISTING CONNECTION TYPE	HEAD ORIENTATION FROM CONNECTION POINT	TYPICAL USES	SEE SHEET ...
<b>1/4" NPT MALE</b> (~9/16" OUTSIDE DIAMETER)	45°	BRADLEY SQUEEZE VALVE DRENCH HOSES; OLDER HAWS DRENCH HOSES	2 OF 13
	90°	SPEAKMAN PULLDOWN DECK-MOUNT EYEWASHES	3 OF 13
<b>3/8" NPT FEMALE</b> (~9/16" INSIDE DIAMETER)	STRAIGHT	GUARDIAN DRENCH HOSES & DRENCH HOSE EYEWASHES W/ ANGLED MOUNTS; SPEAKMAN HOSE DRENCH HOSES & DRENCH HOSE EYEWASHES W/ ANGLED HEADS; BRADLEY PUSH FLAG LABORATORY EYEWASHES	4 OF 13
	45°	GUARDIAN & SPEAKMAN DRENCH HOSES & DRENCH HOSE EYEWASHES	5 OF 13
	90°	DECK-MOUNTED EYEWASHES WHERE THE AXION HEAD MUST BE REPOSITIONED	6 OF 13
<b>3/8" NPT MALE</b> (~1 1/16" OUTSIDE DIAMETER)	90° & EYEWASH ARM	BRADLEY DRENCH HOSES & DRENCH HOSE EYEWASHES W/ SQUEEZE VALVES OR PUSH FLAGS	7 OF 13
	45°	BRADLEY DRENCH HOSES & DRENCH HOSE EYEWASHES W/ SQUEEZE VALVES OR PUSH FLAGS	8 OF 13
<b>1/2" NPT FEMALE</b> (~3/4" INSIDE DIAMETER)	90°	VARIOUS GUARDIAN / BRADLEY / WATERSAVER / SPEAKMAN / OLDER HAWS LABORATORY EYEWASHES W/ PULLDOWN VALVES, SWING VALVES, OR PUSH FLAGS	9 OF 13
	STRAIGHT	SPEAKMAN LABORATORY EYEWASHES W/ SWING VALVES OR PUSH FLAGS	10 OF 13
	45°		11 OF 13
	90° & EYEWASH ARM		12 OF 13

- CONSULT THE SHEET INDICATED IN THE TABLE.
  - ENSURE THAT THE AXION HEAD WILL DIMENSIONALLY COMPLY WITH ANY APPLICABLE REQUIREMENTS (E.G., ANSI & ADA).
  - ENSURE THAT THE AREA BENEATH THE HEAD IS SUFFICIENT TO CAPTURE ANY WATER EMITTED (REQUIRED AREA DEPENDS UPON INSTALLATION, BUT A 5" [127mm] RADIUS FROM THE CENTER OF THE HEAD IS RECOMMENDED).
  - EYE/FACE WASH STREAM HEIGHT IS DEPENDENT UPON INSTALLATION; IF FLOW IS PROHIBITIVELY LOW, CONTACT HAWS TECHNICAL SUPPORT (1-800-766-5612).
- SEE THE FINAL SHEET FOR AXION FLOW CONTROL CLEANING INSTRUCTIONS.





**Haws**

1455 KLEPPE LANE  
SPARKS, NEVADA 89431  
(775) 359-4712 FAX (775) 359-7424  
E-MAIL: HAWS@HAWSCO.COM  
WEBSITE: WWW.HAWSCO.COM

ENCL: 5735	REV: 5735	BY: JLC	MODEL(S): AX16 AXION@ ADVANTAGE™
DRAWN: 10/15/12	DATE: 09/27/12	CHKD: DP	
APPROVED: 10/15/12	DATE: 09/27/12	SCALE: 1:2	DRAWING TYPE: INSTALLATION
			SHEET: A
			SHEET 1 OF 13

# RETROFIT TO 1/4" NPT MALE CONNECTIONS, WITH AXION HEAD 45° FROM CONNECTION

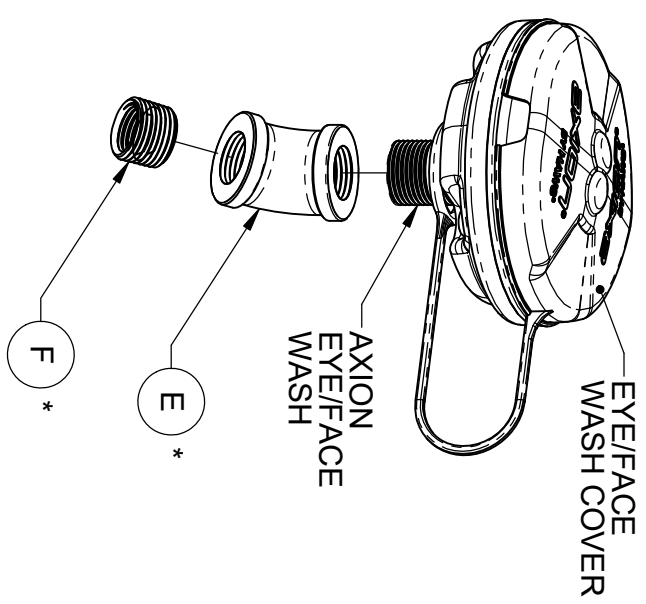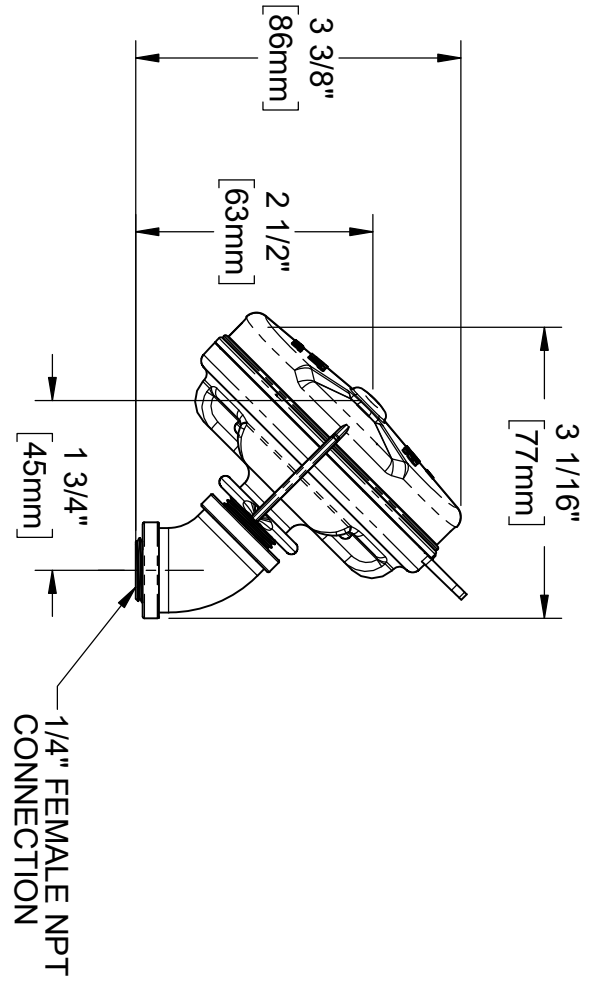


## NOTES

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

## INSTALLATION INSTRUCTIONS



1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 09/27/21	BY: JLC	MODEL(S) AX16 AXION@ ADVANTAGE™
DRAWN: CHR.D	DATE: 08/13/21	CHKD: DP	
APPROVED: [Signature]	DATE: 09/27/21	SCALE: 1/2"	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 2 OF 13
			PART NUMBER 0510002012.D
			REVISION 1

**RETROFIT TO 1/4" NPT MALE CONNECTIONS, WITH AXION HEAD 90° FROM CONNECTION**

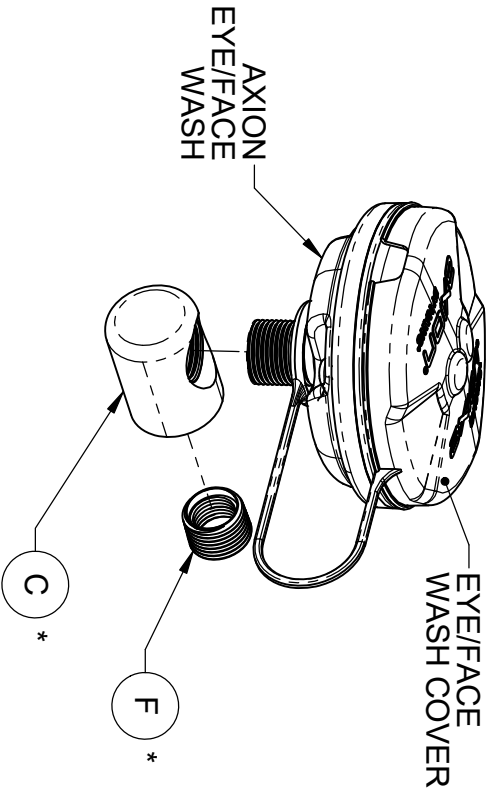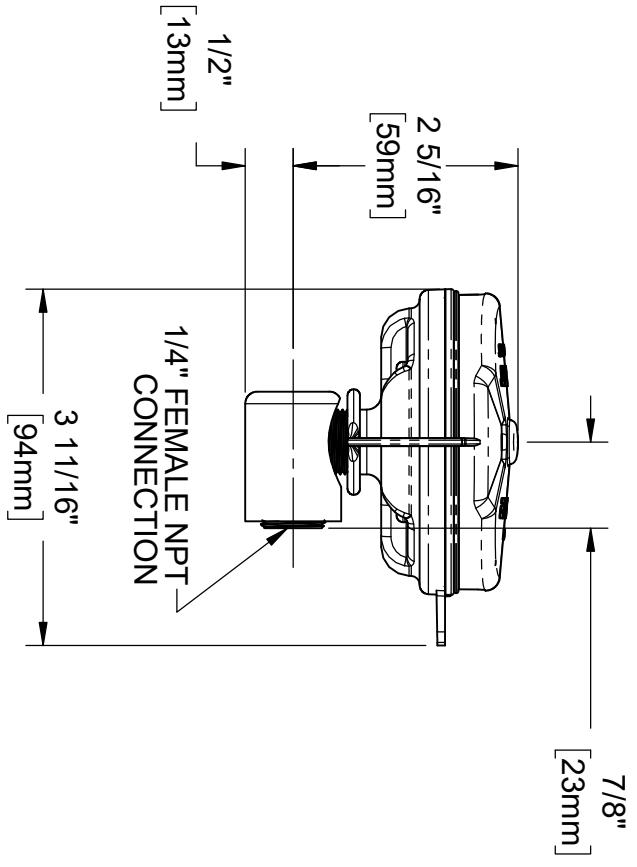

**NOTES**

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

**INSTALLATION INSTRUCTIONS**



1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 08/13/12	BY: JLC	MODEL(S)	AX 16 AXION@ ADVANTAGE™	PART NUMBER
DRAWN: CHS	DATE: 08/13/12	CHKD: DP	SCALE: 1/2"	DRAWING TYPE: INSTALLATION	0510002012.D
APPROVED: [Signature]	DATE: 09/27/12	SCALE: 1/2"	DRAWING TYPE: INSTALLATION	SIZE: A	REVISION 1

## RETROFIT TO 3/8" NPT FEMALE STRAIGHT CONNECTIONS

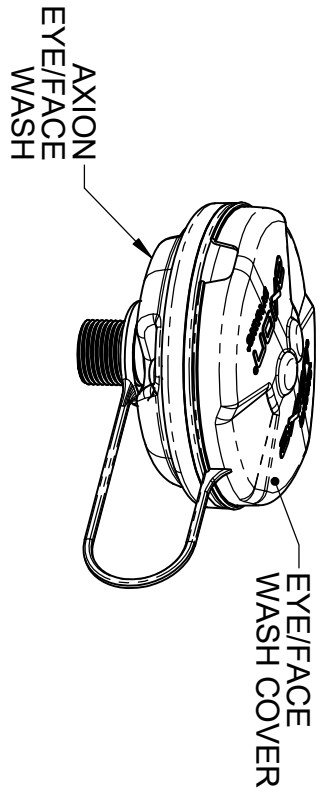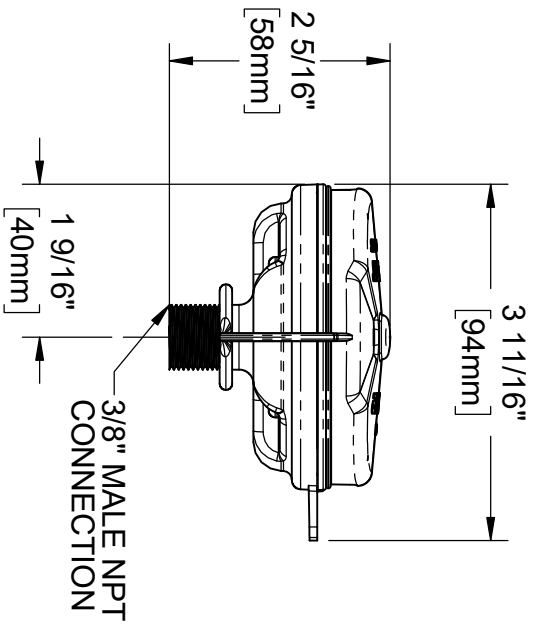


**NOTES**

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

### INSTALLATION INSTRUCTIONS



1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC. USE SUITABLE SEALANT ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 08/15/12	BY: JLC	MODEL(S) AX16 AXION@ ADVANTAGE™
DRAWN: CHS	DATE: 08/15/12	CHKD: DP	
APPROVED: [Signature]	DATE: 09/27/12	SCALE: 1:2	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 1 OF 13
			PART NUMBER 0510002012.D
			REVISION 1

# RETROFIT TO 3/8" NPT FEMALE CONNECTIONS, WITH AXION HEAD 45° FROM CONNECTION

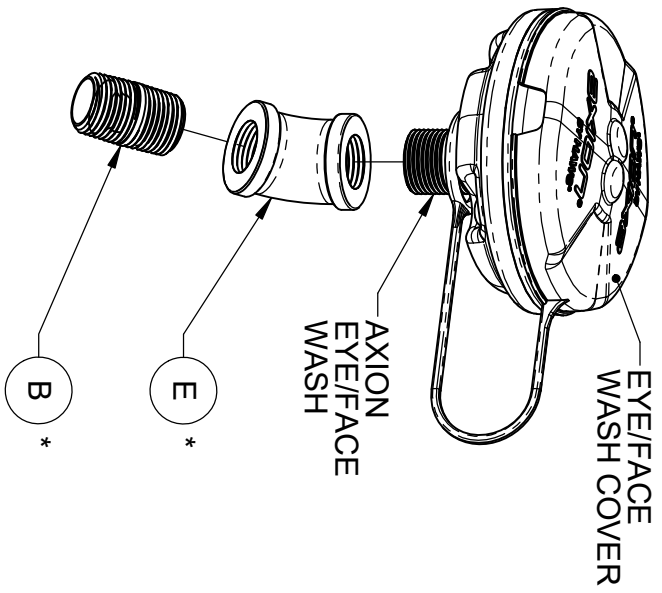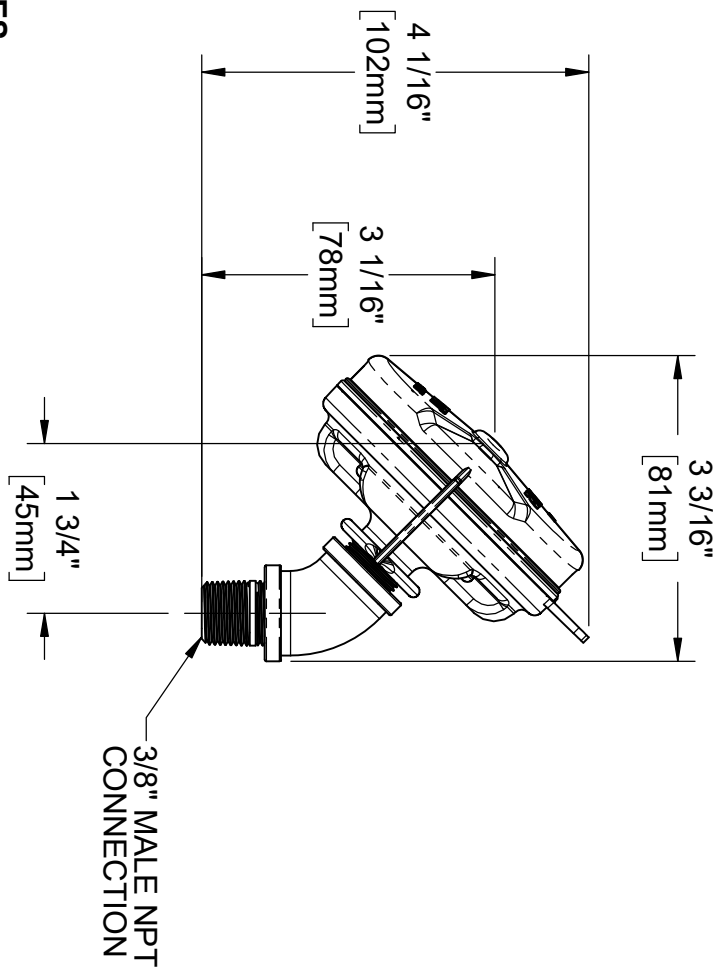


## NOTES

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

## INSTALLATION INSTRUCTIONS



1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL:	REV/ENCL:	BY:	MODEL(S)
5735	5735	JLC	AX16 AXION@ ADVANTAGE™
DRAWN:	DATE:	CHK'D:	
	08/15/11	DP	
APPROVED:	DATE:	SCALE:	12
	09/27/21	DRAWING TYPE:	INSTALLATION
		SIZE:	A
		SHEET:	6 OF 13
		PART NUMBER:	0510002012.D
		REVISION:	1

**RETROFIT TO 3/8" NPT FEMALE CONNECTIONS, WITH AXION HEAD 90° FROM CONNECTION**

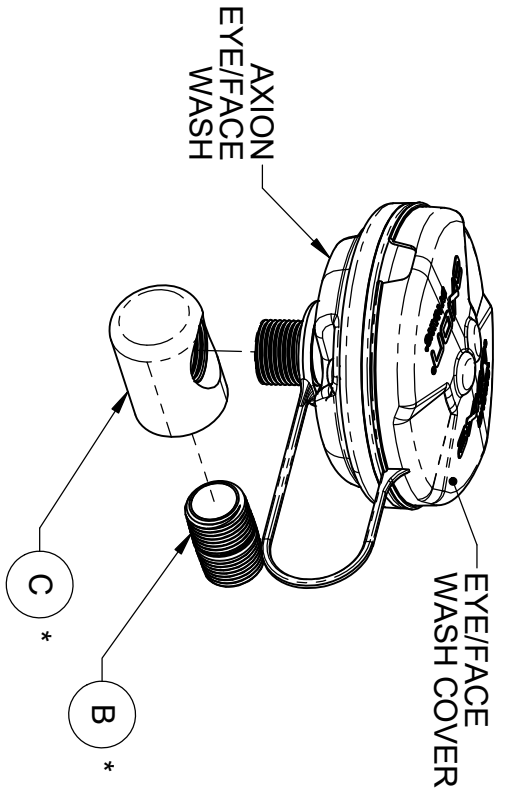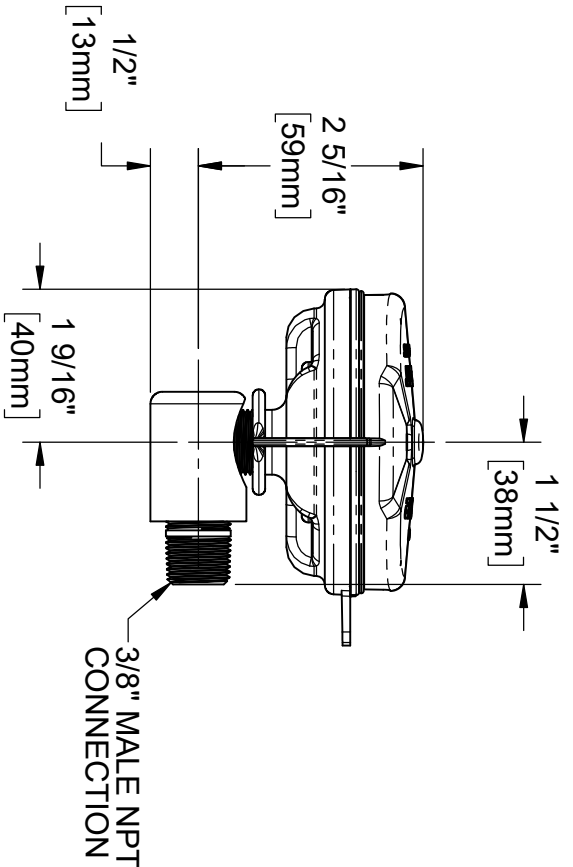

**NOTES**

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

**INSTALLATION INSTRUCTIONS**

1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 5735	BY: JLC	MODEL(S) AX16 AXION@ ADVANTAGE™
DRAWN: CHS	DATE: 08/13/12	DP	
APPROVED: [Signature]	DATE: 09/27/12	SCALE: 1:2	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 6 OF 13
		PART NUMBER 0510002012.D	REVISION 1







# RETROFIT TO 3/8" NPT FEMALE CONNECTIONS, WITH AXION HEAD AT 90° AND JOGGED

**NOTES**  
 NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

**INSTALLATION INSTRUCTIONS**



1. FLUSH SYSTEM TO REMOVE DEBRIS PRIOR TO INSTALLING HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. JOGGED BEND MAY BE REVERSED OR FLIPPED AS NEEDED. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
4. TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
5. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
6. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.

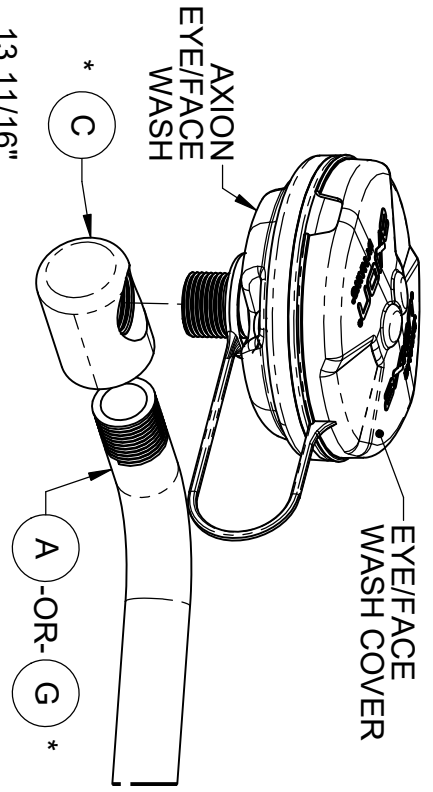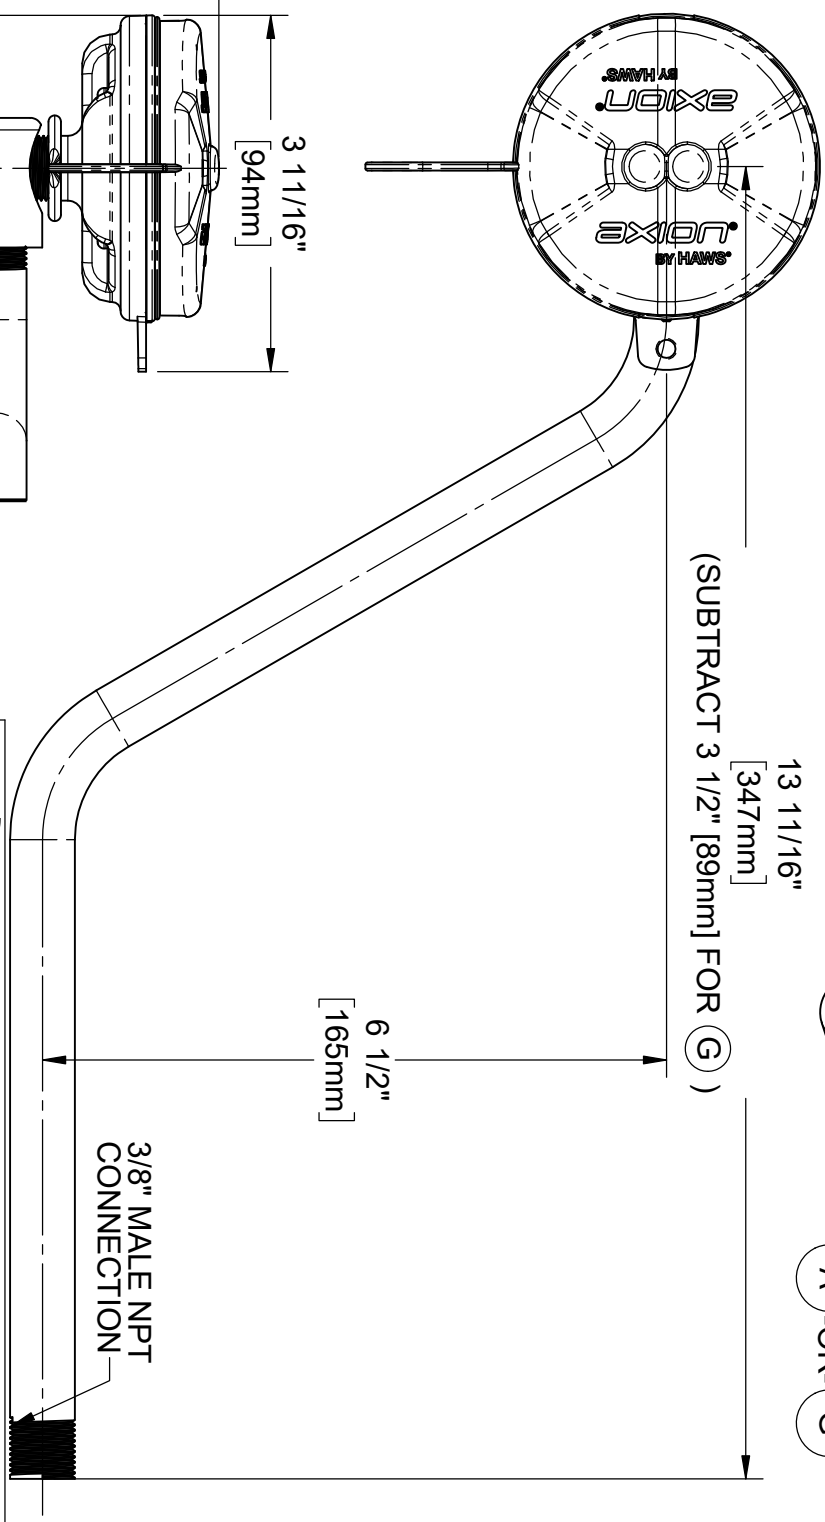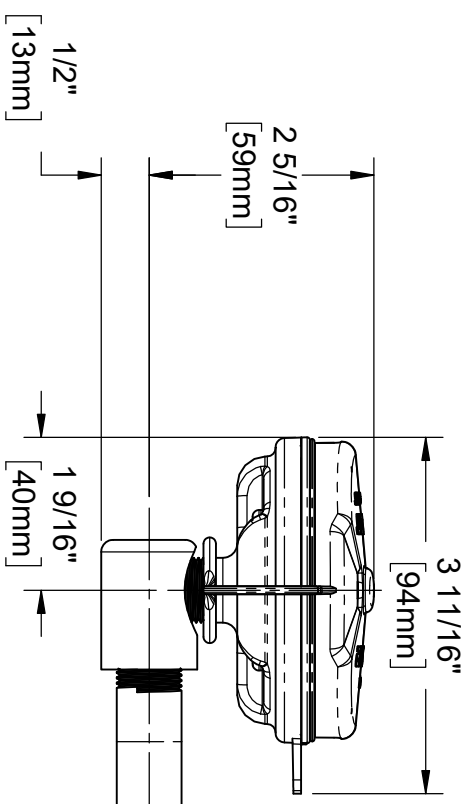

1455 KLEPPE LANE  
 SPARKS, NEVADA, 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL:	REV. E/CN:	BY:	MODEL(S)
5735	5735	JL	AX16 AXION@ ADVANTAGE™
DRAWN:	DATE:	CHK'D:	
APPROVED:	DATE:	DP:	
09/27/21	SCALE:	1:2	DRAWING TYPE: INSTALLATION
	SIZE:	A	SHEET OF 13
	REVISION:	1	
	PART NUMBER:	0510002012.D	

# RETROFIT TO 3/8" NPT MALE CONNECTIONS, WITH AXION HEAD 45° FROM CONNECTION

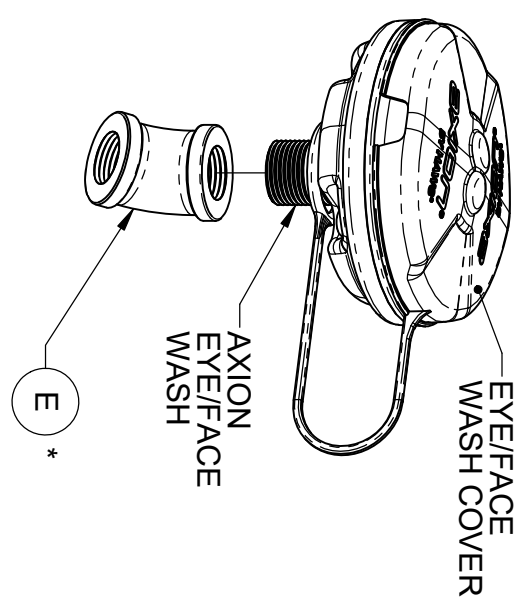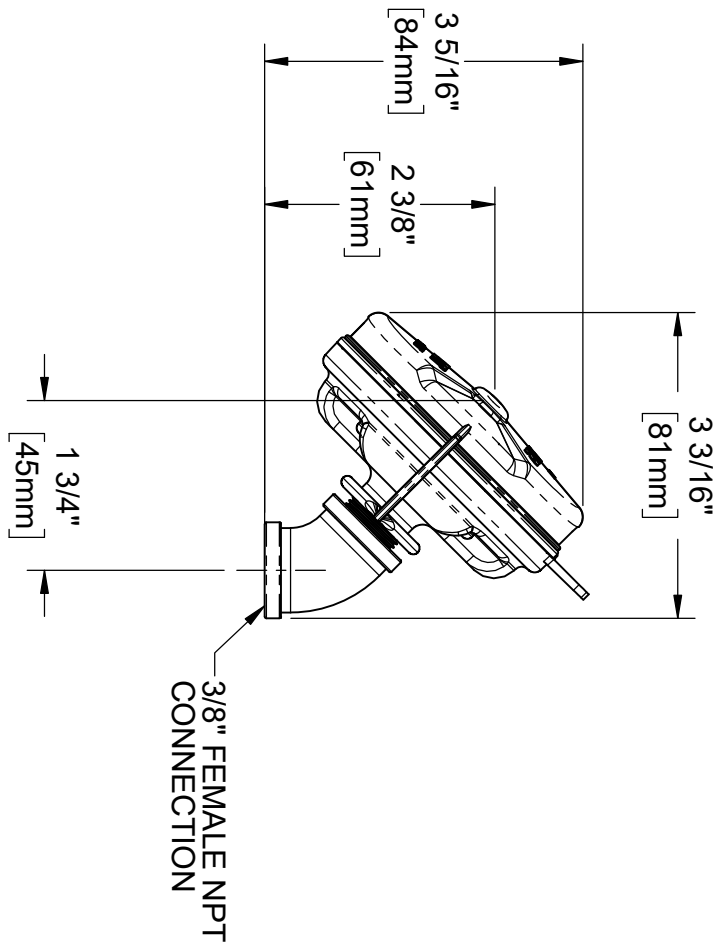

## NOTES

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

## INSTALLATION INSTRUCTIONS



1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 09/27/21	BY: JLC	MODEL(S) AX16 AXION@ ADVANTAGE™
DRAWN: CHR.D	DATE: 08/11/21	CHKD: DP	
APPROVED: [Signature]	DATE: 09/27/21	SCALE: 1:2	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 8 OF 13
			PART NUMBER 0510002012.D
			REVISION 1

**RETROFIT TO 3/8" NPT MALE CONNECTIONS, WITH AXION HEAD 90° FROM CONNECTION**

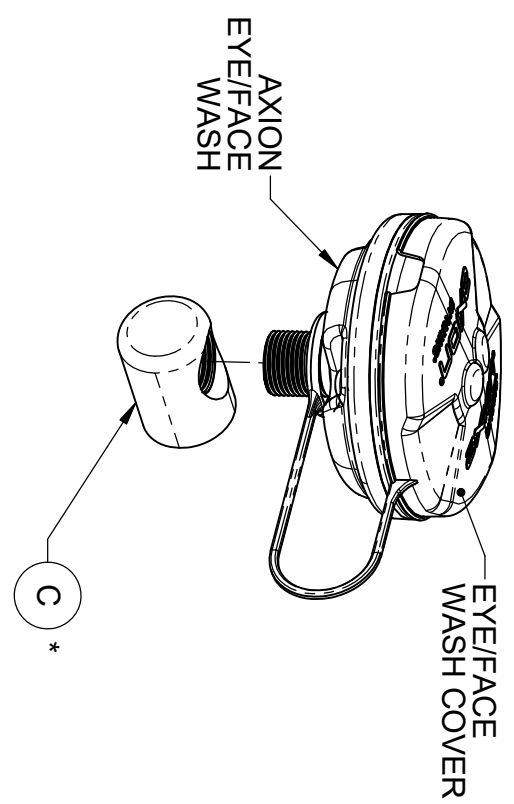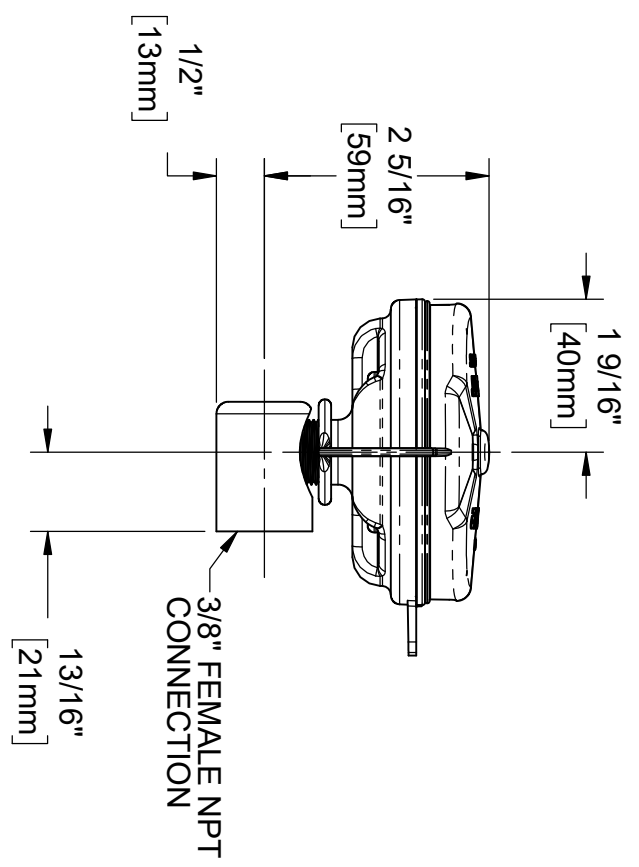

**NOTES**

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

**INSTALLATION INSTRUCTIONS**



1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 5735	BY: JLC	MODEL(S) AX16 AXION@ ADVANTAGE™
DRAWN: CHS	DATE: 08/13/12	CHKD: DP	
APPROVED: [Signature]	DATE: 09/27/12	SCALE: 1:2	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 9 OF 13
			PART NUMBER 0510002012.D
			REVISION 1

## RETROFIT TO 1/2" NPT FEMALE STRAIGHT CONNECTIONS

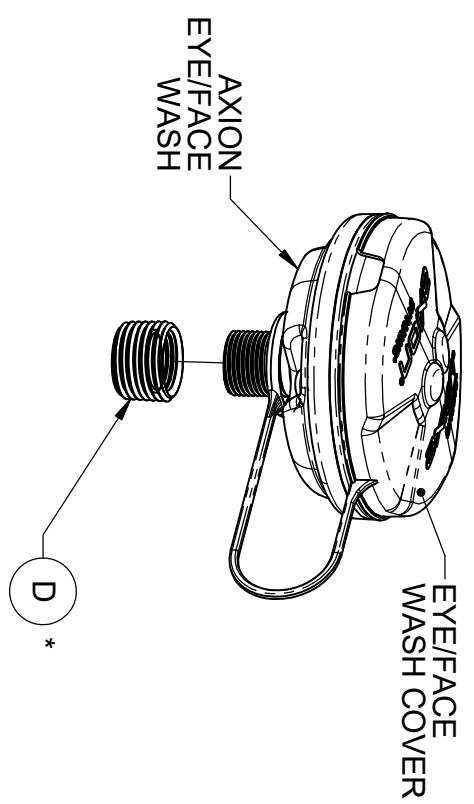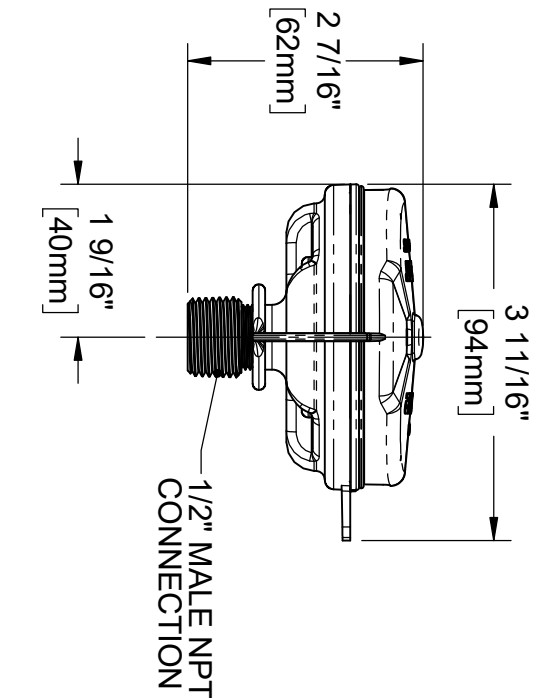


**NOTES**

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.

\* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

### INSTALLATION INSTRUCTIONS


1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.



1455 KLEPPE LANE  
 SPARKS, NEVADA 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWS.CO.COM  
 WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 1	BY: JLC	MODEL(S)	AX 16 AXION@ ADVANTAGE™
DRAWN: CHS	DATE: 08/15/12	CHKD: DP		
APPROVED: [Signature]	DATE: 09/27/12	SCALE: 1:2	DRAWING TYPE: INSTALLATION	SIZE: A
				SHEET 10 OF 13
				REVISION 1
				PART NUMBER 0510002012.D

# RETROFIT TO 1/2" NPT FEMALE CONNECTIONS, WITH AXION HEAD 45° FROM CONNECTION


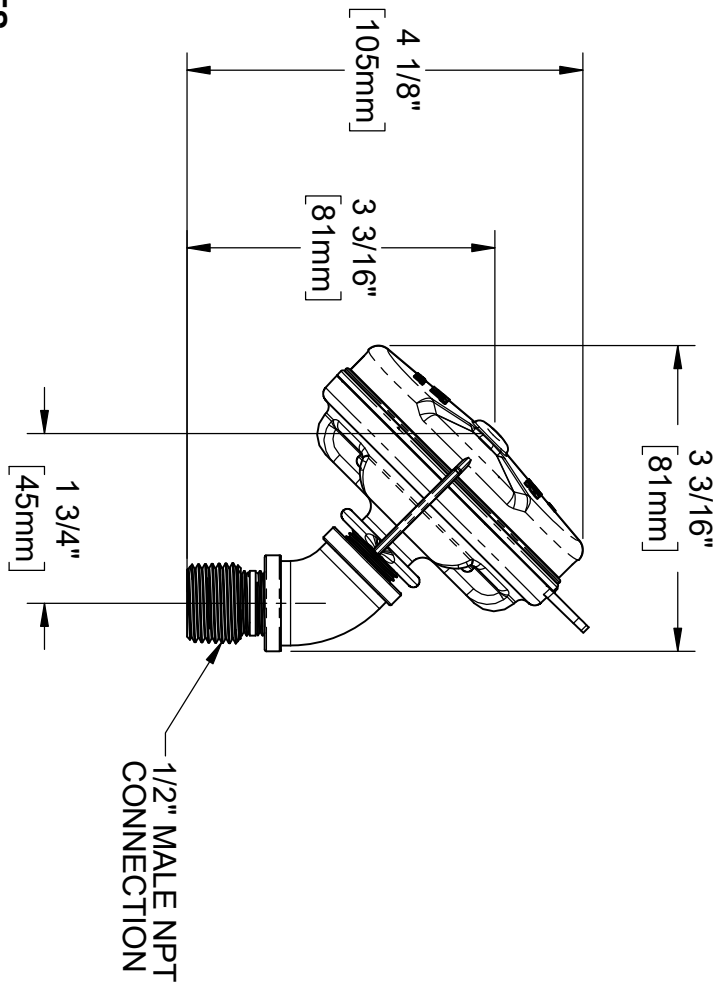


**NOTES**

NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.

## INSTALLATION INSTRUCTIONS

1. FLUSH SYSTEM TO REMOVE LINE DEBRIS PRIOR TO INSTALLING AXION HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS.
  - TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
4. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS.
5. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.

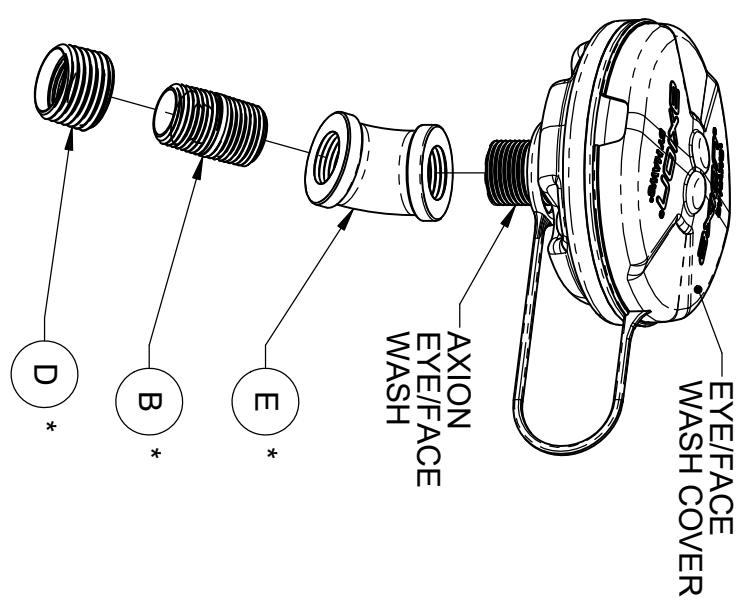

1455 KLEPPE LANE  
 SPARKS, NEVADA, 89431  
 (775) 359-4712 FAX (775) 359-7424  
 E-MAIL: HAWS@HAWSCO.COM  
 WEBSITE: WWW.HAWSCO.COM



ENCL:	REV. E/CN:	BY:	MODEL(S)
5735	DATE:	JLC	AX16 AXION@ ADVANTAGE™
DRAWN:	DATE:	CHR.D	
APPROVED:	DATE:	DP	
9/27/21	SCALE:	1:2	DRAWING TYPE: INSTALLATION
	SIZE:	A	SHEET 11 OF 13
	PART NUMBER		
	0510002012.D		
	REVISION		
	1		

# RETROFIT TO 1/2" NPT FEMALE CONNECTIONS, WITH AXION HEAD AT 90° AND JOGGED

**NOTES**  
 NOT FOR USE ON ANY FREEZE RESISTANT UNITS.  
 \* NOTE CORRESPONDING LETTERS ON PARTS BREAKDOWN DRAWING.


**INSTALLATION INSTRUCTIONS**

1. FLUSH SYSTEM TO REMOVE DEBRIS PRIOR TO INSTALLING HEAD.
2. INSERT AXION SHANK THROUGH DUST COVER LOOP BEFORE CONNECTING FITTINGS.
3. JOGGED BEND MAY BE REVERSED OR FLIPPED AS NEEDED. AXION HEAD IS ABS PLASTIC AND METALLIC FITTINGS ARE CHROME-PLATED. USE SUITABLE SEALANT(S) ON THREADS. TAKE CARE NOT TO CROSS THREAD THE AXION HEAD DURING INSTALLATION.
5. ORIENT TAB ON AXION HEAD TOWARD BACK OF UNIT. DO NOT OVERTIGHTEN AXION HEAD THREADS. FULLY TEST UNIT AND CHECK FOR ANSI COMPLIANCE USING ENCLOSED CHECKLIST AFTER UPGRADE IS COMPLETE.

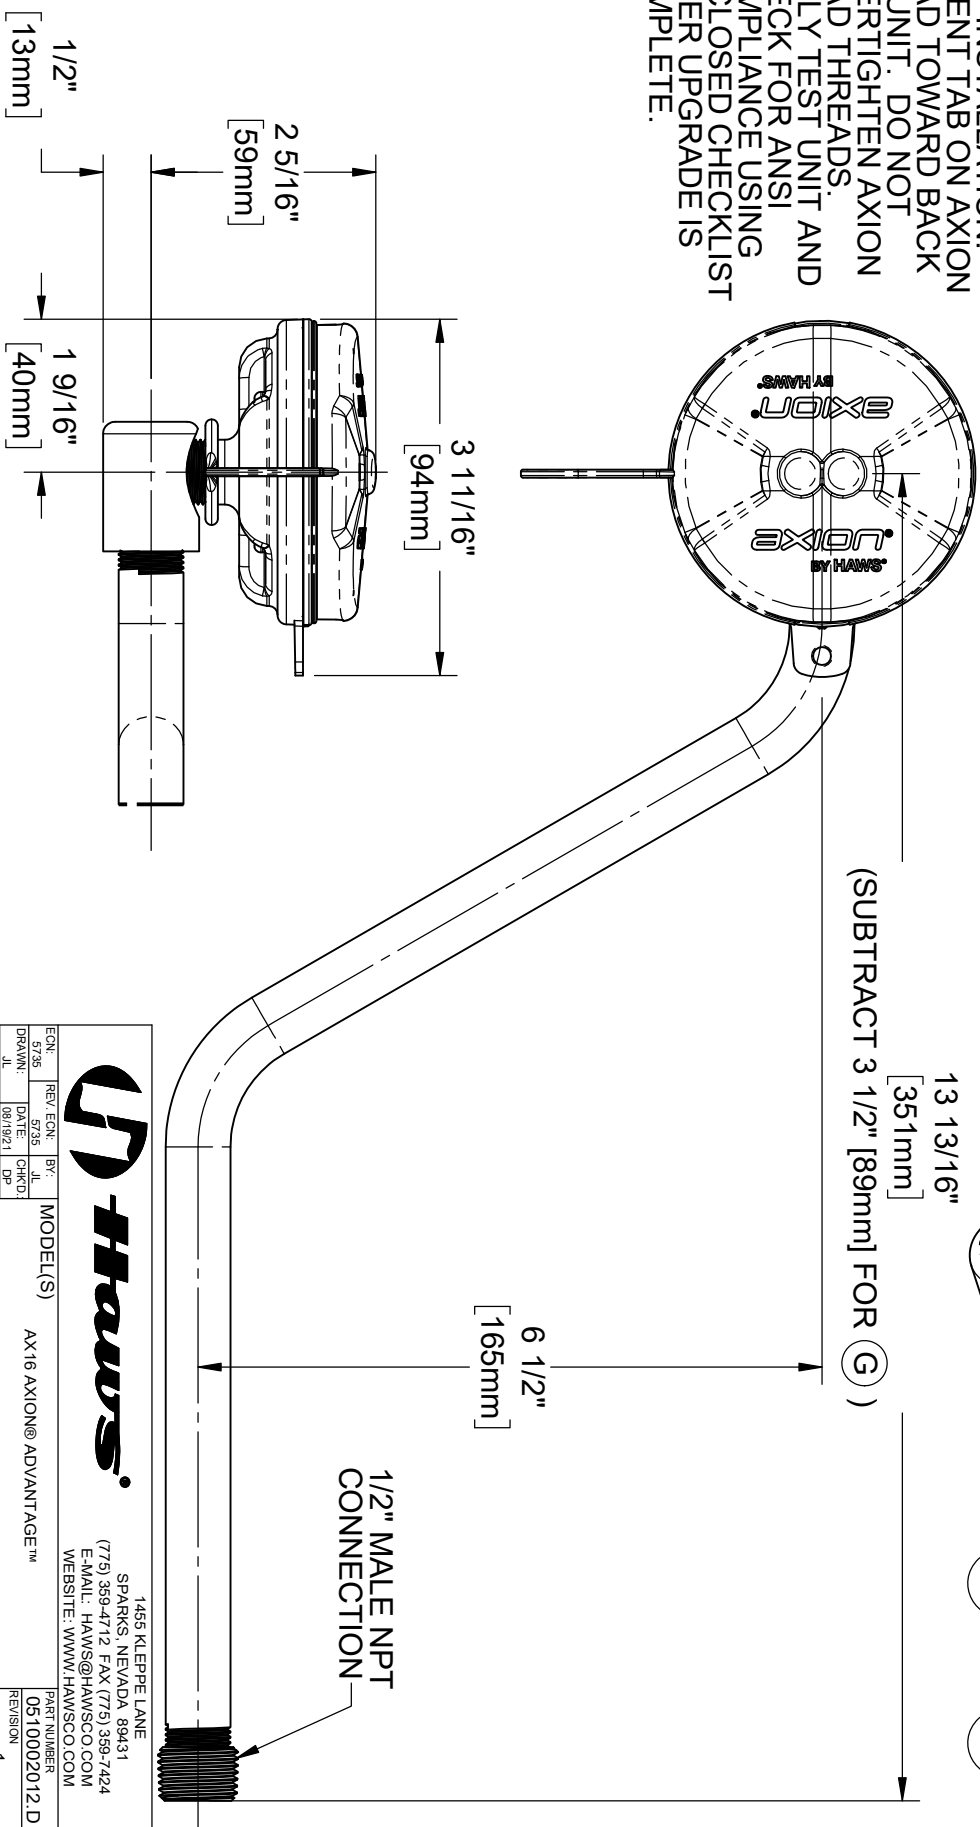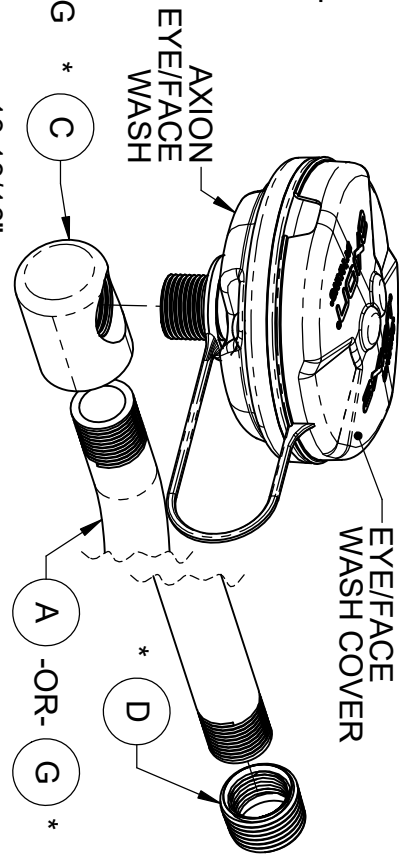


		<b>Haws</b>	
ENCL. 5735	REV. E/CN. 08/15/14	BY: JLC	MODEL(S) AX16 AXION® ADVANTAGE™
DRAWN: CHRD	DATE: 08/15/14	CHK'D: DP	
APPROVED: 09/27/21	DATE: 09/27/21	SCALE: 1:2	DRAWING TYPE: INSTALLATION
1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM		PART NUMBER 0510002012.D	REVISION 1

EYE/FACE WASH HEAD HAS 2 LARGE OPENINGS (FOR EYES) AND MULTIPLE SMALLER OPENINGS (FOR FACEWASH) [2]

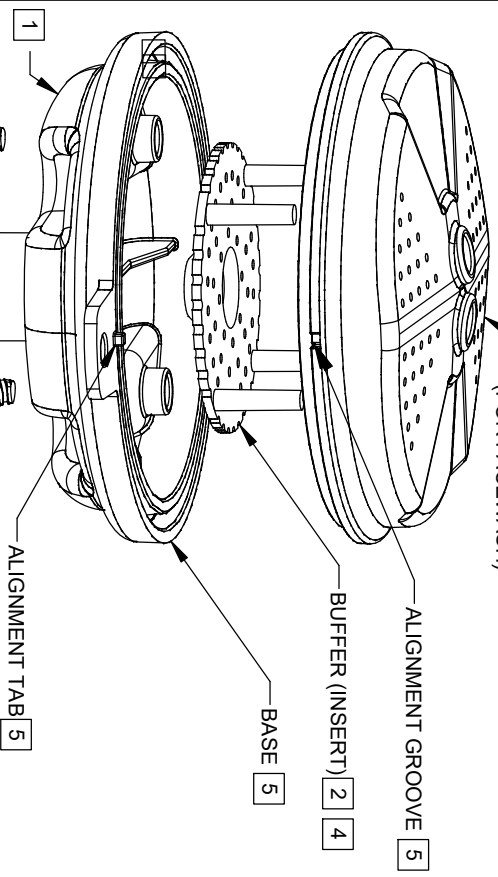

EYE/FACE WASH FLOW CONTROL [3] (COLOR: PINK)

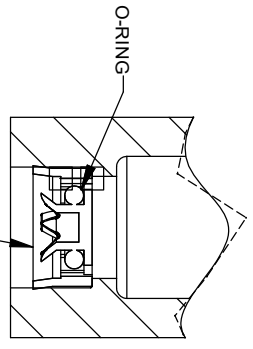


FLOW CONTROL SHOWN IN PLACE  
NOTE: PRESS FLOW CONTROL IN UNTIL IT BOTTOMS OUT

3 DETAIL A

**AXION EYE/FACE WASH CLEANING DETAIL**


**FLOW CONTROL CLEANING STEPS:**

- 1 UNSCREW EYE/FACE WASH ASSEMBLY FROM PLUMBING (NOT SHOWN).
- 2 REMOVE SCREWS (QTY. 4) FROM EYE/FACE WASH ASSEMBLY.
- 3 REMOVE EYE/FACE WASH HEADS AND BUFFER (INSERT).
- 4 REMOVE EXISTING FLOW CONTROL FROM BASE BY PUSHING IT OUT FROM THE TOP, AND CAREFULLY REMOVE ANY DEBRIS LODGED BETWEEN O-RING AND HOUSING OR OPENINGS. ALSO, CHECK FOR ANY SEDIMENT OR MINERAL DEPOSITS BLOCKING OPENINGS. EXERCISE CAUTION NOT TO DAMAGE OR LOSE O-RING IN THE PROCESS. ALL OPENINGS ON FLOW CONTROL MUST BE FREE AND CLEAR OF ANY OBSTRUCTIONS FOR FLOW CONTROL TO FUNCTION PROPERLY. REINSTALL FLOW CONTROL. SEE **DETAIL A** FOR ORIENTATION.
- 5 INSERT BUFFER (INSERT) INTO EYE/FACE WASH HEAD, NOTING ORIENTATION OF POST IN RELATION TO ALIGNMENT GROOVE, AS SHOWN IN **DETAIL B**.
- 6 REASSEMBLE EYE/FACE WASH HEAD, MAKING SURE THAT ALIGNMENT GROOVE ON EYE/FACE WASH HEAD LINES UP WITH ALIGNMENT TAB ON BASE.
- 7 REINSTALL SCREWS (QTY. 4) INTO THE EYE/FACE WASH ASSEMBLY. TIGHTEN SNUG TO ENSURE A WATER-TIGHT SEAL. DO NOT OVERTIGHTEN. TORQUE SPEC: 3 IN LBS. MAX.
- 8 REASSEMBLE EYE/FACE WASH ASSEMBLY ONTO PLUMBING (NOT SHOWN). ORIENT TAB TOWARD THE BACK OF (AWAY FROM USER). DO NOT OVERTIGHTEN. PLACE DUST COVER (NOT SHOWN) ONTO EYE/FACE WASH.




EYE/FACE WASH SHOWN WITHOUT DUST COVER [8]

NOTE ORIENTATION OF POSTS IN RELATIONSHIP TO ALIGNMENT GROOVE. POSTS MUST BE INSIDE OF RIBS (AS SHOWN).

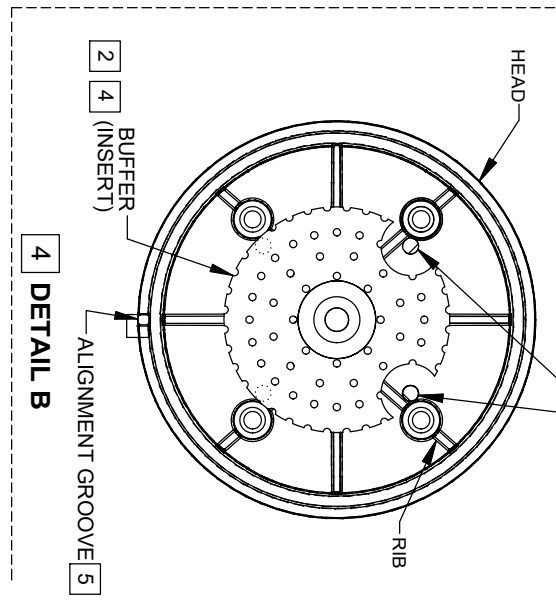

4 DETAIL B



1455 KLEPPE LANE  
SPARKS, NEVADA 89431  
(775) 359-4712 FAX (775) 359-7424  
E-MAIL: HAWS@HAWS.CO.COM  
WEBSITE: WWW.HAWS.CO.COM

ENCL. 5735	REV. E/CN. 09/27/21	BY: JLC	MODEL(S) AX16 AXION@ ADVANTAGE™
DRAWN: CH6D	DATE: 08/15/21	CHKD: DP	
APPROVED: 09/27/21	SCALE: 1:2	DRAWING TYPE: INSTALLATION	SHEET 13 OF 13
PART NUMBER 0510002012.D			REVISION 1